NOTES:

1. NOT FOR CONSTRUCTION.
2. ALL UNITS METRES (m) U.N.O.
3. EVAPORATION PONDS TO BE LINED WITH HDPE.
4. SEDIMENT PONDS UNLINED.
5. PIPE NETWORK SHOWN INDICATIVELY.
6. LINER DETAILS REFER 514I-008.
7. SAFETY ROPE TO BE INSTALLED. REFER 514I-008
8. DISCHARGE PIPE ANCHOR AND LINER PROTECTION REFER 514I-008.

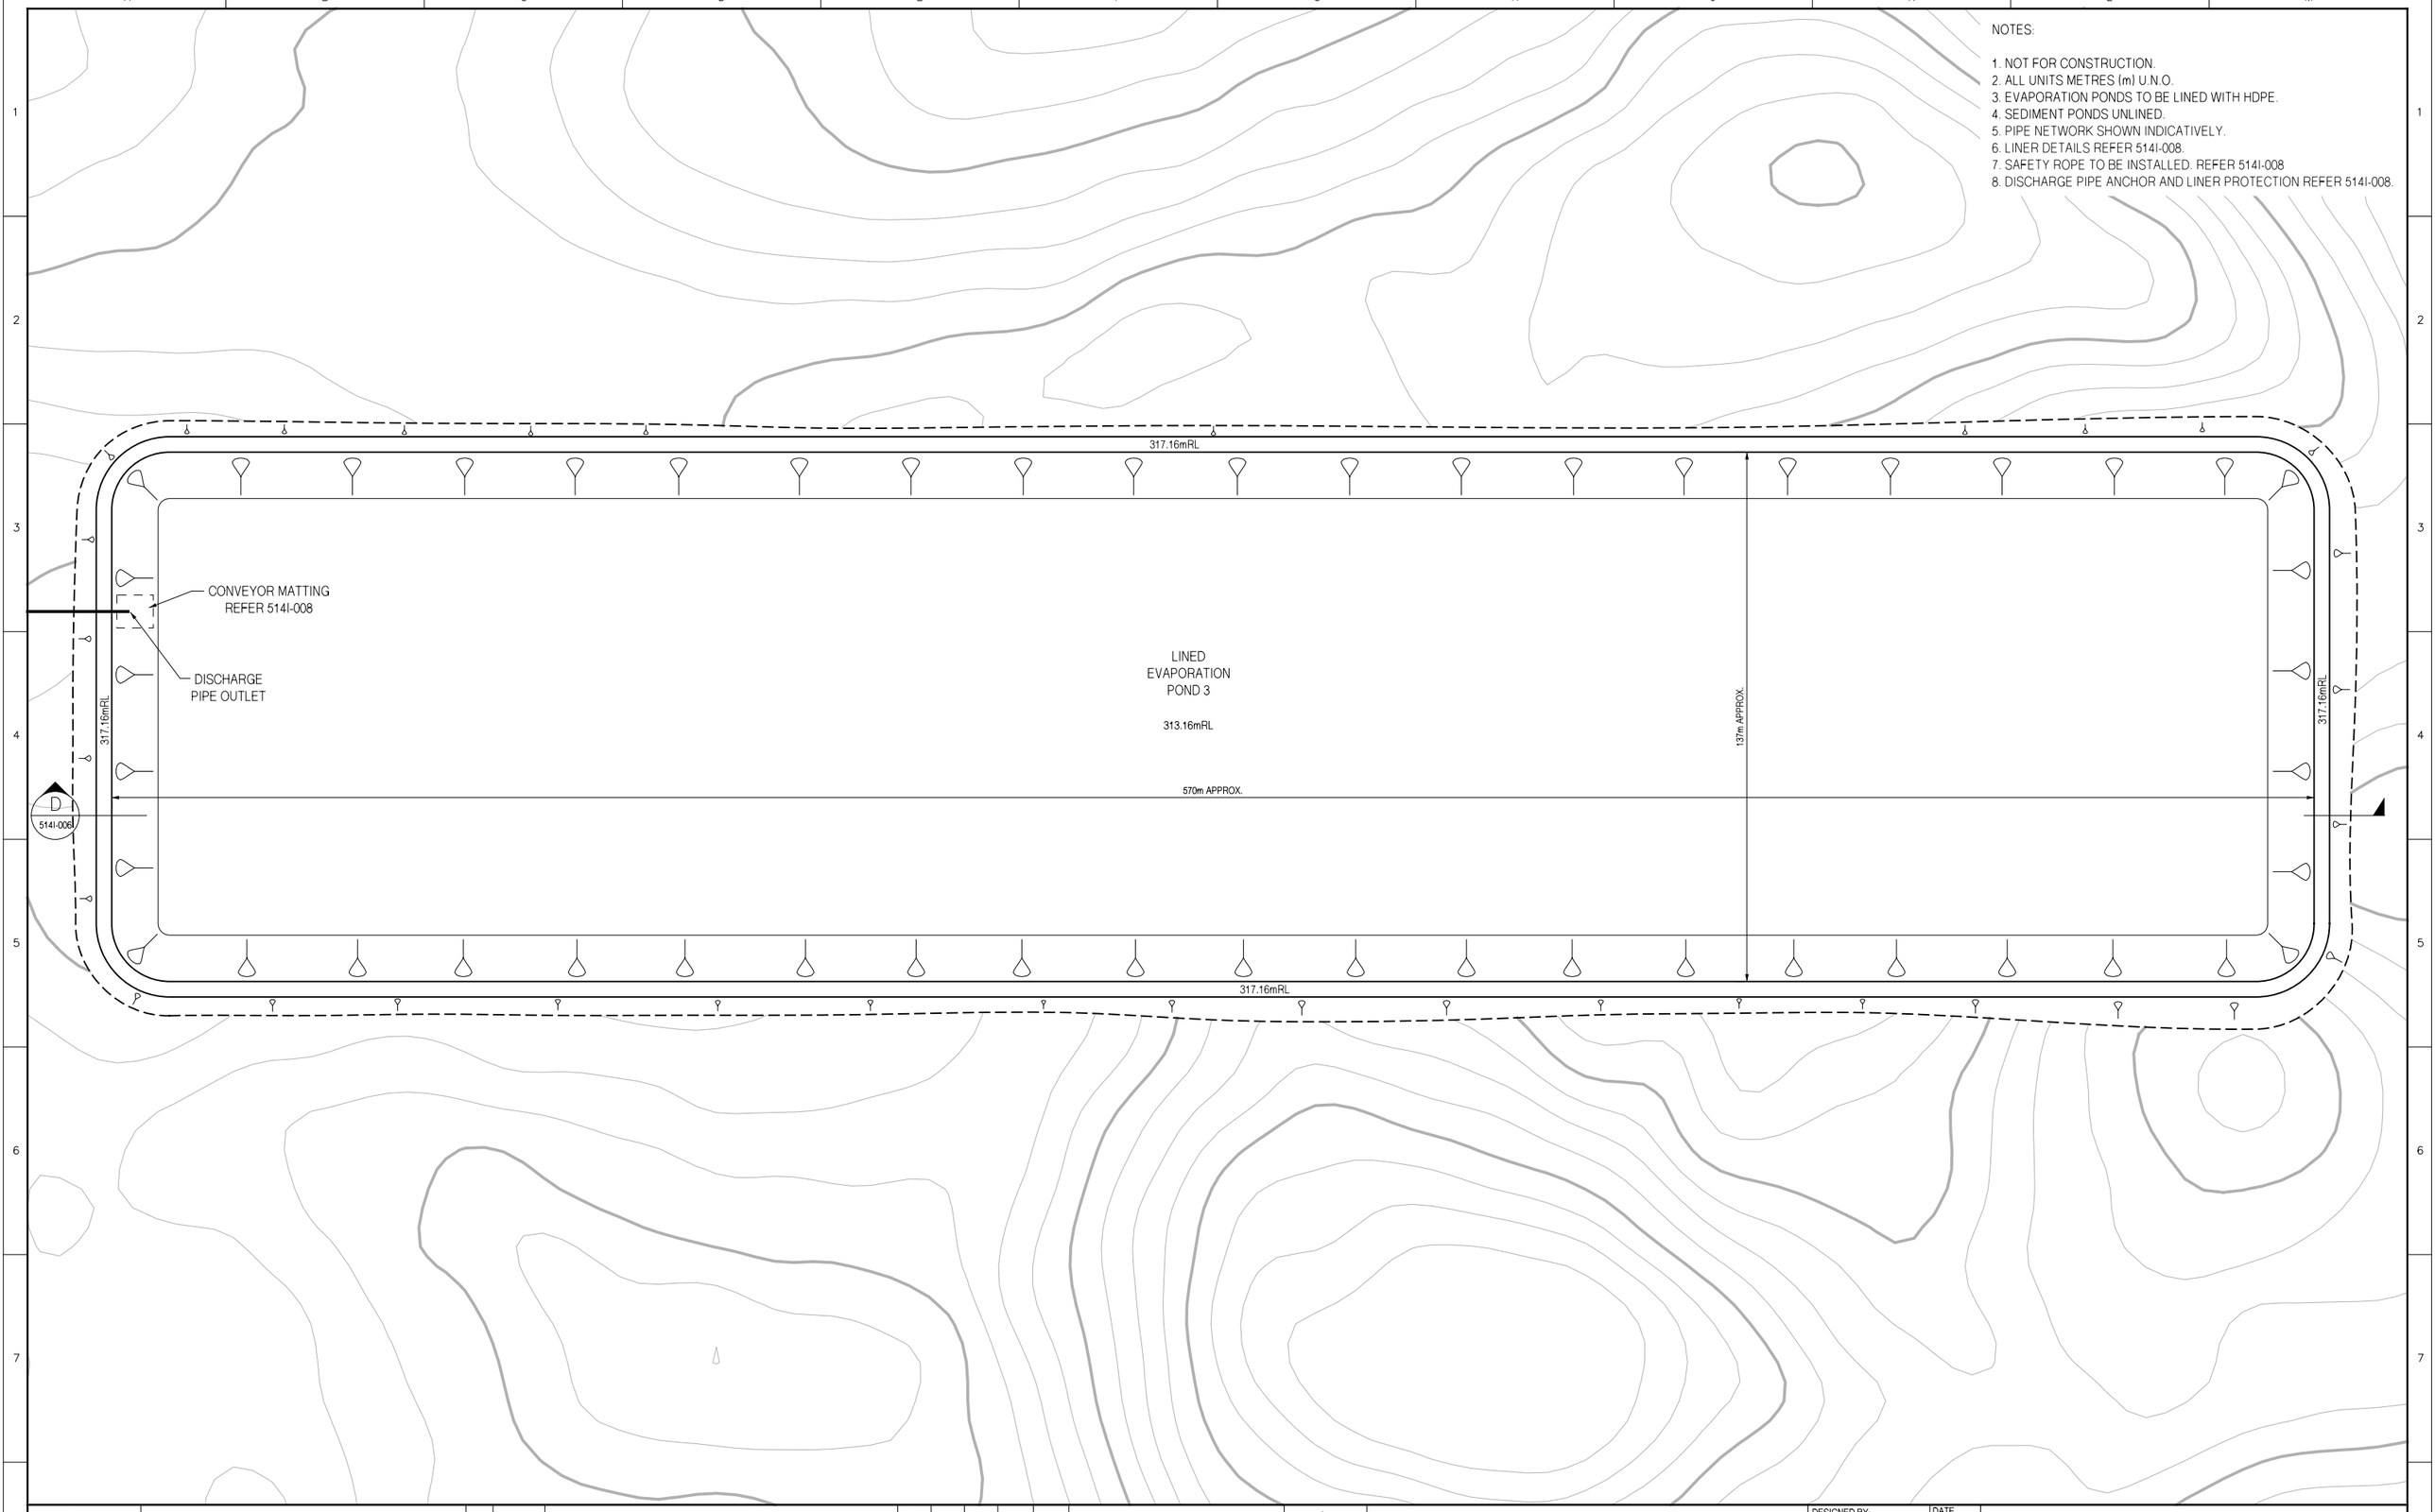

REF DRG NUMBER	REFERENCE DRAWING DESCRIPTION	REV	DATE	REVISION DESCRIPTION	DES	DRN	CHK	APP	CRT
		A	25.05.26	ISSUED FOR INFORMATION ONLY - NOT FOR CONSTRUCTION	MN	CR	MN	MN	

CLIENT PROJECT NUMBER

N

NOT FOR CONSTRUCTION

AQ2

Ground Floor, 1 Howard Street
Perth, WA 6000
Telephone: (08) 9293229733
www.aq2.com.au

DESIGNED BY: M. NICHOLLS	DATE 15.05.26
DRAWN BY: C. REEVES	DATE 25.05.26
CHECKED BY: M.NICHOLLS	DATE --
APPROVED BY: M.NICHOLLS	DATE --
CERTIFIED BY:	DATE
PROJECT No: 514I	

RAMELIUS ROE GOLD PROJECT
PIT DEWATERING MANAGEMENT PLAN
SETTLING AND EVAPORATION PONDS
EVAPORATION POND 3 DETAIL

SCALE 1:750 | A1 | DRAWING NUMBER 514I-006 | REV A